

Installation Instructions

ITEM G-95525

When using electrical equipment, basic safety precautions should always be followed, including the following



Read and follow all safety instructions:

IMPORTANT: Before installing, make certain the AC Power to the fixture is off to avoid electric shock.

IMPORTANT: An un-switched AC power source of 100~347VAC is required.

IMPORTANT: Verify that all replacement lamp types marked on the installed luminaire are also identified as suitable for use with this emergency battery pack.

IMPORTANT: It is recommended to charge the battery every 6 months to prevent over-discharge.

CAUTION: Make sure all electrical connections conform to the National Electrical Code and all applicable local regulations. Proper grounding is required for safety.

CAUTION: RISK OF SHOCK – DISCONNECT EMERGENCY AND NORMAL INPUT POWER SOURCES BEFORE SERVICING.

CAUTION: Risk of fire or electric shock. Luminaire wiring and electrical parts may be damaged when drilling for installation of LED Emergency Backup. Check for enclosed wiring and components.

CAUTION: Risk of fire or electric shock. This LED Emergency Backup installation requires knowledge of luminaire electrical systems. If not qualified, do not attempt installation. Contact a qualified electrician.

CAUTION: To prevent wiring damage or abrasion, do not expose wiring to edges of sheet metal or other sharp objects.

CAUTION: Do not handle energized fixture when hands are wet, when standing on wet or damp surfaces, or in water.

CAUTION: The electrical rating of this product is 100-347V AC. Installer must confirm that there is 100-347Vac to the fixture before installation.

CAUTION: This is a sealed unit. Components are not replaceable. Replace the entire LED Emergency Backup unit when necessary.

CAUTION: Equipment should be mounted in locations and at heights where it is not be subjected to tampering by unauthorized personnel.

Suitable for use in damp locations and dry locations where the ambient temperature is 5°C minimum, +50°C maximum.

Not for use in heated air outlets or hazardous locations.

Do not use outdoors.

Do not let power supply cords touch hot surfaces.

Do not mount near gas or electric heaters.

Do not use this equipment for other than its intended use.

The use of accessory equipment is not recommended by the manufacturer and may cause an unsafe condition.

Use with grounded, UL Listed, dry or damp location rated fixtures.

IMPORTANT: Indicator (LED light) illuminated indicates battery in charge mode when AC power is applied. It is recommended and required by applicable code to test emergency function to ensure proper operation of the system; push the test switch for thirty (30) seconds every 30 days to ensure the emergency driver is functioning as LED light source illuminated. Conduct a ninety minute (90) discharge test one time (1) per year; LED light source should be illuminated for a minimum of ninety minutes (90).

AC Operation AC power is present. The AC driver operates the LED load as designed. The emergency driver is charging in a standby mode. The charging indicator will be lit, showing that the battery is charging.

Emergency Operation. When the AC power goes out, the emergency driver detects the AC power outage and automatically switch to emergency mode. The red LED light on indicates that it is discharging, the red LED flashes to indicate low battery power. The red LED light off indicates that the discharge is complete. When AC power is restored, the emergency driver backs to AC mode and starts recharging.


Malfunction Operation:

When the emergency LED driver fault, the yellow LED on




Indicator Light Introduction

- 1) Green/Flashing: Charging
- 2) Green/ON: Full-charged
- 3) Red/ON: Discharging(emergency mode)
- 4) Red/Flashing: Low battery
- 5) Yellow: Error

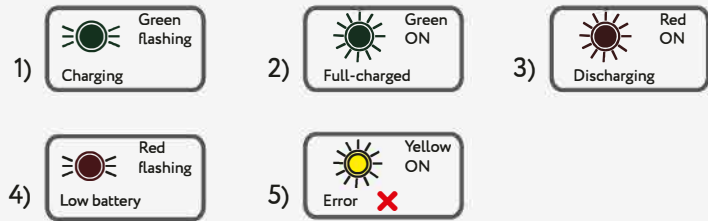

Test Switch Introduction

- 1) Press the test switch to confirm whether emergency function is normal
- 2) During Emergency Mode, Press test switch twice to cut off the emergency output and enter Shipping Mode



WIRING DIAGRAM



CAUTION: The Emergency LED Driver must connect to 0-10V dimming wires(DIM+,DIM-) of the luminaire if the LED luminaire power is exceed the emergency LED driver power.


MODEL ITEM G-95515

Input Voltage: 100-347Vac, 50/60Hz
Input Current: ≤ 100mA
Input Power: 12W Max.
Output Voltage: 170V DC
Input Current: ≤ 100mA

Output Power: 25W
Ambient Temperature: 5°C ~ 50°C (41°F ~ 122°F)
Application: (1) ≤ 150W (0-10V dimming luminaire)
 (2) ≤ 25W
Max. Mounting Height: 27.2ft

WIRING DIAGRAM 1: With 0-10V dimming LED Driver

For luminaire with 0-10V LED driver and using 0-10V dimmer (LED DRIVER INPUT POWER NOT GREATER THAN 150W) Emergency Driver Dim+ (Green), Dim- (Yellow) has to connect with LED driver DIM+ and DIM- respectively, as shown.

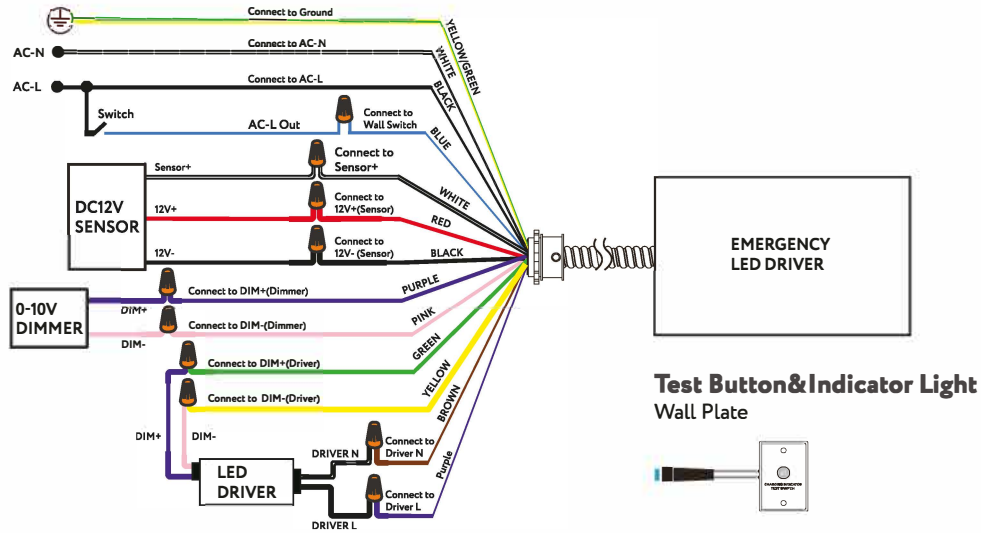


Note:

1. If using sensor, sensor wires must remove from LED Driver and reconnect to Emergency driver DC 12V wires for EM Driver to function properly.
2. Cap off if not using dimmer switch
3. Cap off if not using sensor

WIRING DIAGRAM 2: With non dimming LED Driver

For luminaire with non dimming LED driver (LED DRIVER INPUT POWER NOT GREATER THAN 25W).

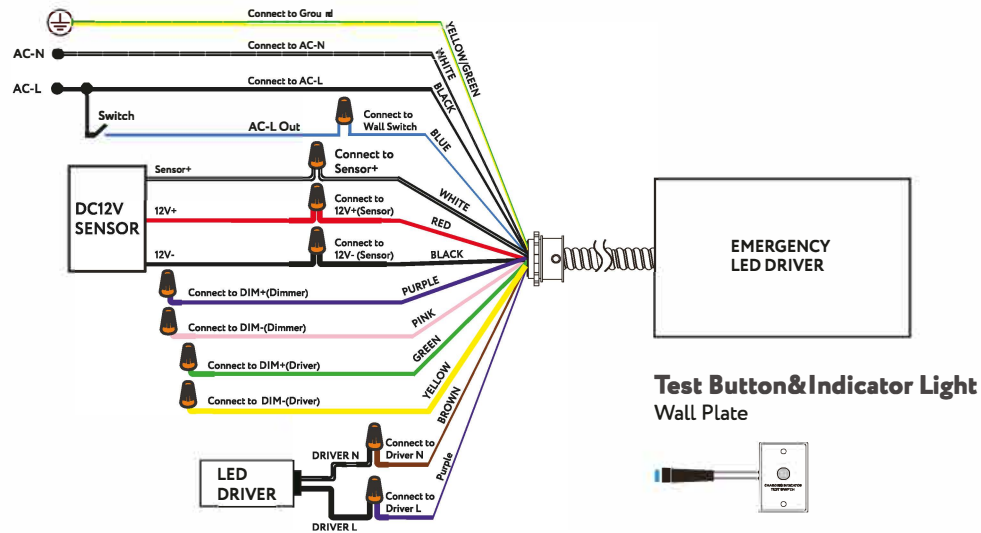


Note:

1. If using sensor, sensor wires must remove from LED Driver and reconnect to Emergency driver DC 12V wires for EM Driver to function properly.
2. Cap off if not using sensor

WIRING DIAGRAM 3: With triac dimming LED Driver

For triac dimmable LED luminaires (* LED DRIVER INPUT POWER NOT GREATER THAN 25W)

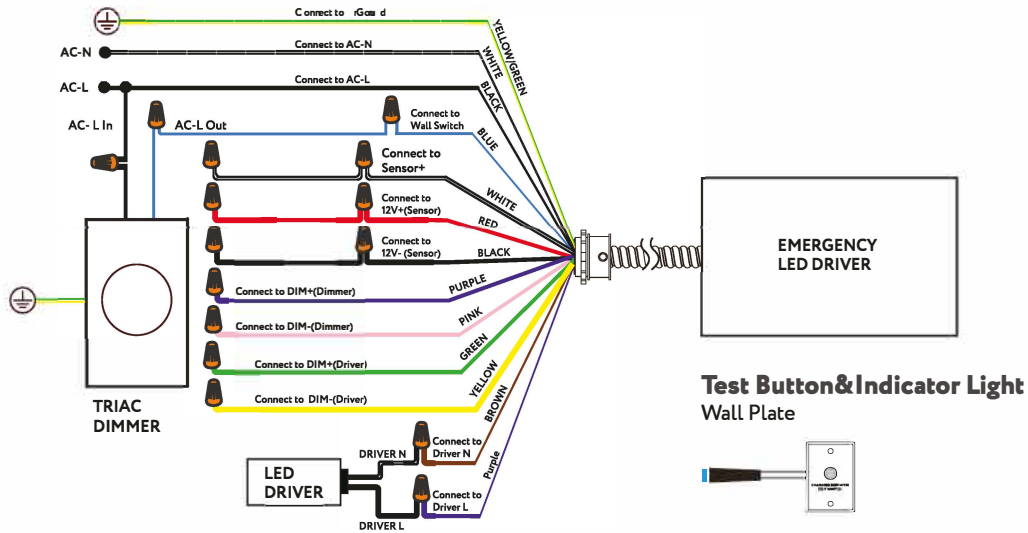

Note:
1. Verify compatibility before installation

* During Emergency Mode, Press testing button twice to cut off the emergency output and enter Shipping Mode

PRODUCT INCLUDES THE FOLLOWING COMPONENTS:	QUANTITY
LED Emergency Driver:	1
Charging Indicator/Testing Button:	1
Charging Indicator/Testing Button Wall Cover:	1
Instruction Sheet:	1